PHYSICAL TESTING REPORT





PCP Gratings Ltd

Enterprise Drive Four Ashes Wolverhampton West Midlands WV10 7DF

FAO: Mr. Adam Carpenter

Report of Tests on: PcP B Cube Oyster Pressing - Machine Manufactured

Your Reference: PcP B Cube - Oyster Pressing

Lucideon Reference: (193087)-25452/Supplement Report

Date Reported:	06-Jun-2019	Order Number:	BACS
Date Logged:	30-May-2019	Date(s) of Test(s):	04-Jun-2019 to 04-Jun-2019

Inclined Platform Test for Slip Resistance In Shod Conditions

DIN 51130:2014

	Operator 1 - Angle of Inclination	Operator 2 - Angle of Inclination
No.	0	0
1	35.6	34.8
2	36.1	34.7
3	35.5	34.4

Description of Test Specimen(s): 1m x 0.5m metal grid

Average of Six Shod Results (Corrected): 35.8 °

Category: R13

The critical angle at which a test person reaches the limit of safe walking on an inclined plane is used as a measure of slip resistance.

Opinions and interpretations expressed herein are outside the scope of UKAS Accreditation.




Manager

Supplement to Test Report dated 05.05.19 Ref: (193087)-25452 Inclined Platform Test for Slip Resistance In Shod Conditions.

This report is issued in accordance with the Conditions of Business of Lucideon Limited and relates only to the sample(s) tested. No responsibility is taken for the accuracy of the sampling unless this is done under our own supervision. This report shall not be reproduced in part without the written approval of Lucideon Limited, nor used in any way as to lead to misrepresentation of the results or their implications. Lucideon Limited Queens Road, Penkhull Stoke-on-Trent Staffordshire ST4 7LQ Page 1 of 2

T +44 (0)1782 764428 enquiries@lucideon.com www.lucideon.com

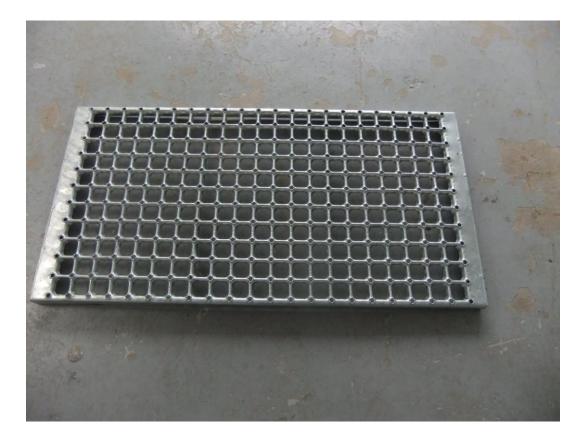

END OF TEST REPORT